Figure 4.7: Core Sample Locations Floor 23

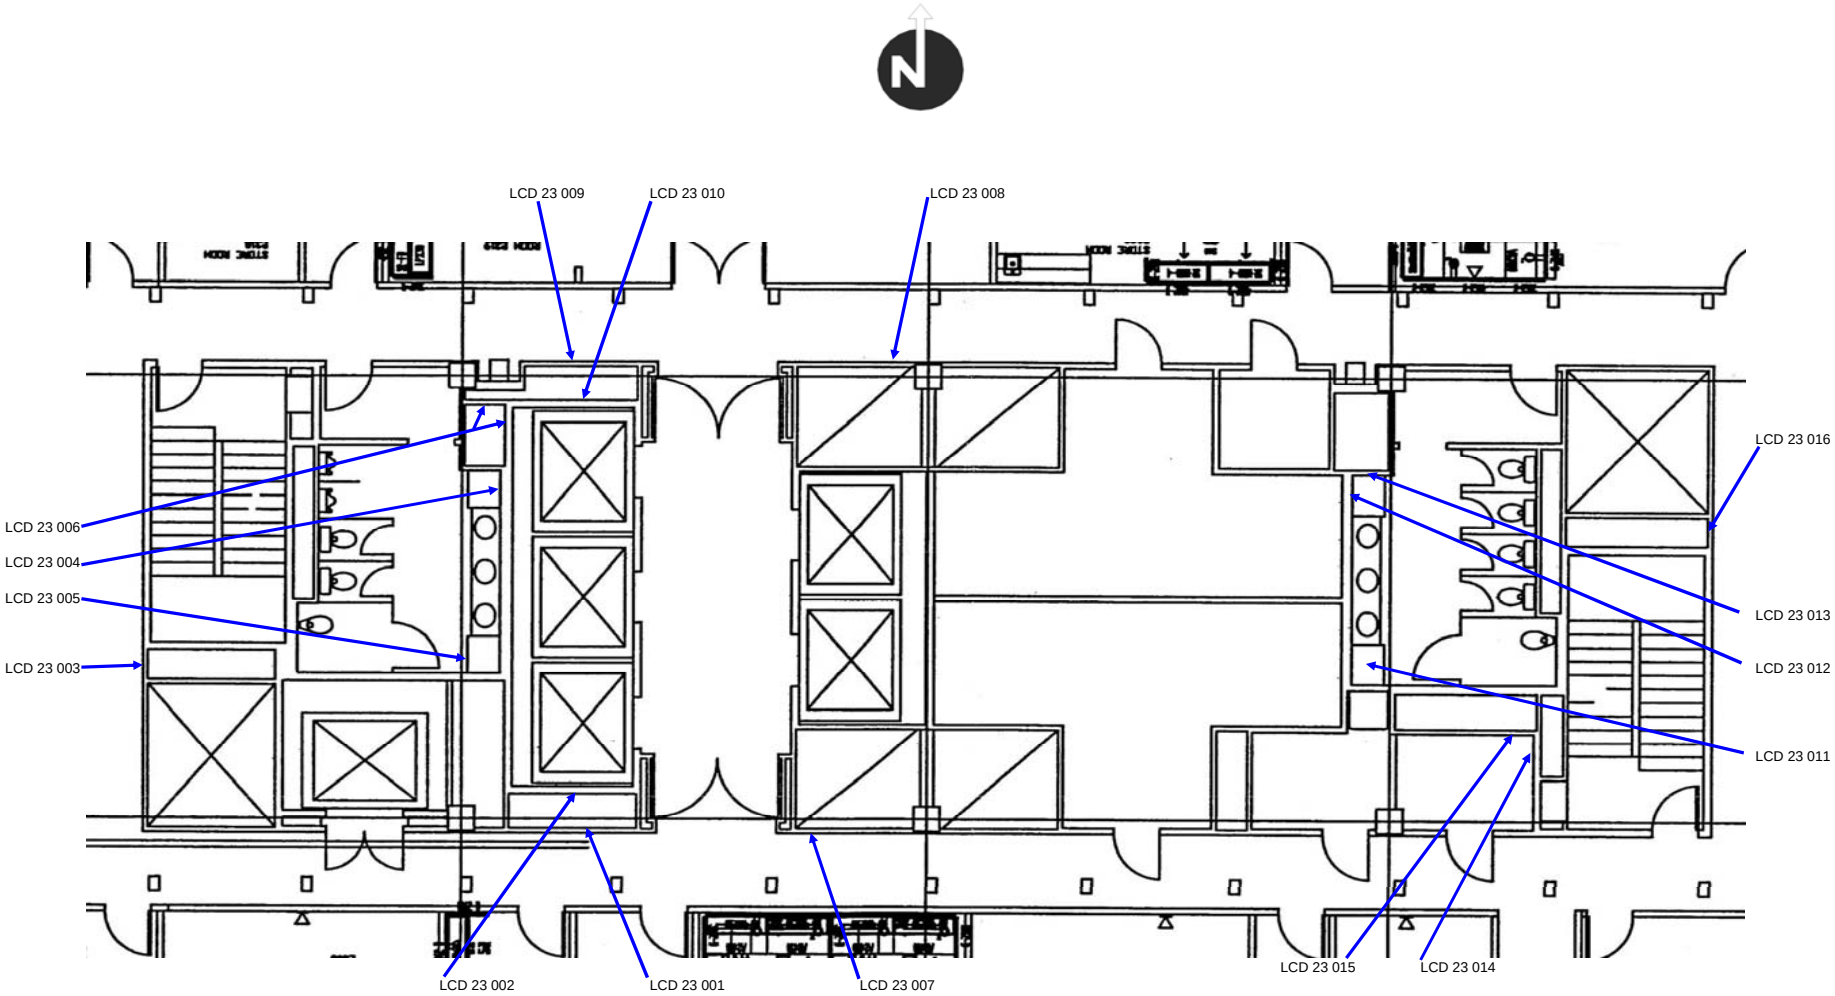

CONFIDENTIAL